


Rawe Home Heat Pump Models

Top Floor Unit - 215BNA024000GAAB

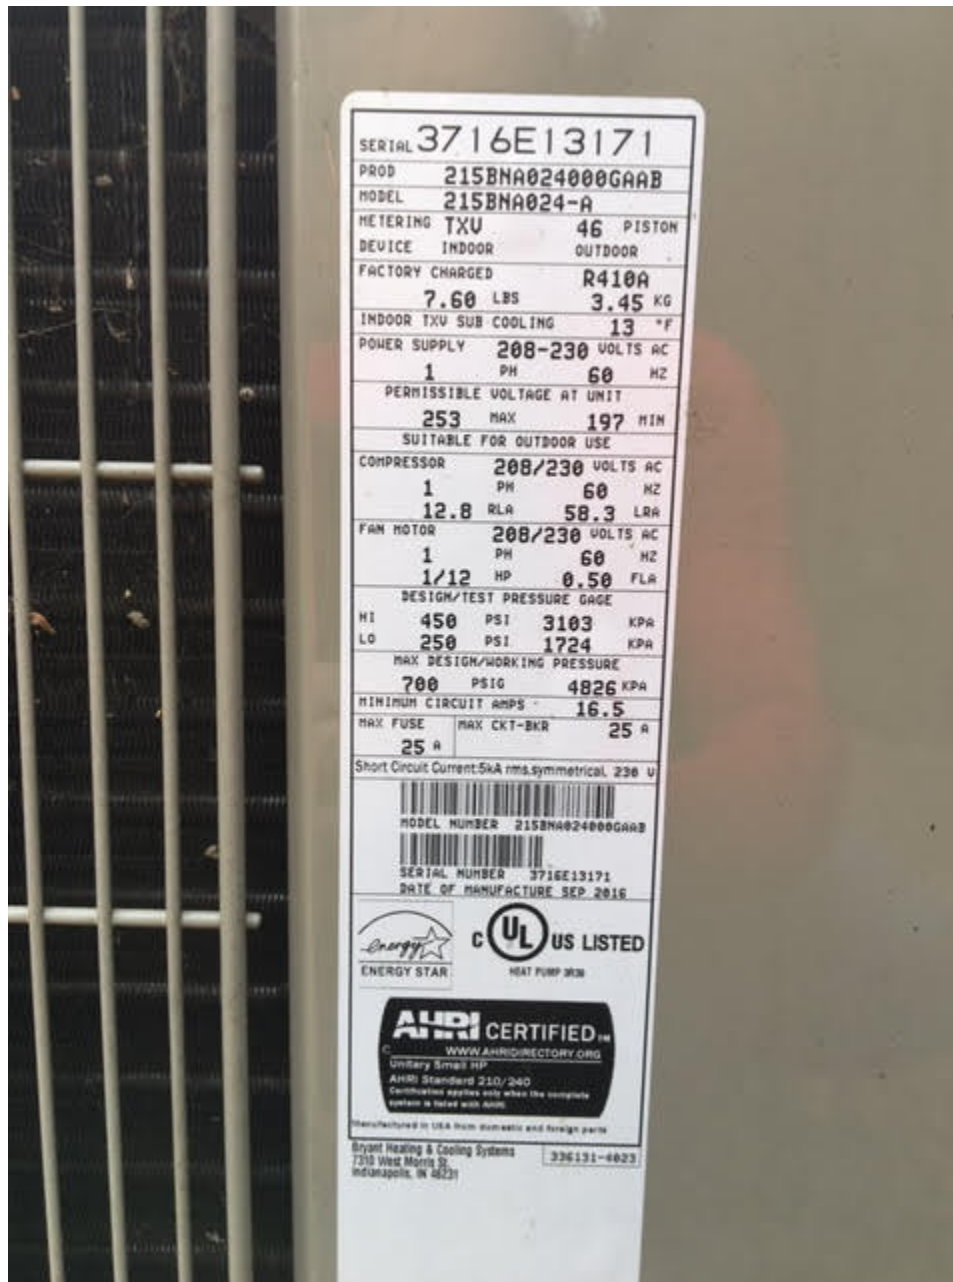

Top Floor Furnace - FV40NF002

PRODUCT NO.	FV4CNF002L00ABAA	 LISTED FURNACE UNIT SHORT CIRCUIT CURRENT: 5KA RMS, SYMMETRICAL, 230V
MODEL NO.	FV4CNF002	
SERIAL NO.	4016A87162	
VOLTS	208/230	
MOTOR HP	1/2	
MOTOR FLA	4.3	
PHASE/HERTZ	1/60	
TEST STATIC	0.50 IN. W.C.	
REFRIGERANT	410A	DESIGN PSIG 450
DATE OF MANUFACTURING	OCT 2016	

APPROVED ACCESSORIES			
KFCEH**01N05	KFCEH**01C05	KFCEH**01N08	KFCEH**01C08
KFCEH**01N09	KFCEH**01N10	KFCEH**01C10	KFCEH**01F15
KFCEH**01C15	KFCEH**01315	KFCEH**01318	KFCEH**01F20
KFCEH**01C20			

** - NUMERIC

ELECTRICAL INFORMATION FOR THIS UNIT	
INSTALLER: APPLY THIS INFORMATION TO THE ELECTRICAL INFORMATION	
RATING PLATE: SEE INSTALLATION INSTRUCTIONS FOR 1" CLEARANCE REQUIREMENTS	
SINGLE SUPPLY CIRCUIT: 208/230	PHASE 1
HEATER AMPS: 3	MIN. AMPACITY: 53.8/55.5
SUPPLY CIRCUIT: 1	OVERCURRENT PROTECTION: 60/60
HEATER AMPS: 3	MIN. AMPACITY: 53.8/55.5
HEATER AMPS: 3	MAX. OVERCURRENT PROTECTION: 60/60
HEATER AMPS: 3	MIN. AMPACITY: 53.8/55.5
HEATER AMPS: 3	MAX. OVERCURRENT PROTECTION: 60/60

HEAT PACKAGE IN THIS UNIT	
KFCEH2801C10A	LABEL P/N 324848-431 REV. A

UNIT HAS INTEGRAL LIMIT CONTROL. MAX. OUTLET TEMP. 200F.
 MOTOR IMPEDANCE PROTECTED.
 SEE INSTALLATION INSTRUCTIONS FOR SPECIFIC INSTALLATION REQUIREMENTS AND APPROVED ACCESSORY KIT INFORMATION.
 MAX. VOLTAGE TO GROUND OF SUPPLY CIRCUIT NOT TO EXCEED 120 VOLTS IF HEATER HAS CIRCUIT BREAKER CONTROL.
 COIL FOR COOLING ONLY EXCEPT WHEN INSTALLED AS PART OF A LISTED HEAT PUMP.
 APPROVED HEATERS MFG BY CAC/BDP IN INDIANAPOLIS, IN.
 CLEARANCE TO COMBUSTIBLE MATERIALS TO BE 0" FOR CASING, PLENUM AND DUCT FOR UNITS WITH 0 TO 18KW HEATERS.
 FOR UNITS WITH HEATERS 20KW AND ABOVE, CLEARANCE TO COMBUSTIBLE MATERIAL IS TO BE 0" TO CASING AND 1" FOR FIRST 36" OF PLENUM AND DUCT.

CAUTION METERING DEVICE FOR THIS COIL MUST MATCH THAT SHOWN ON OUTDOOR UNIT RATING PLATE. REPLACE IF NECESSARY.
 THIS UNIT IS EQUIPPED WITH METERING DEVICE: TXV

CAC/BDP
 7310 West Morris St.
 Indianapolis, IN 46231 U.S.A.

Model Number FV4CNF002L00ABAA

340097 - 4001 Rev. A

Serial Number 4016A87162

Manufactured in USA from domestic and foreign parts.

Main Floor Furnace - FB4ANF060000AFAA

PRODUCT NO.	FB4ANF060000AFAA
MODEL NO.	FB4ANF060
SERIAL NO.	2401A64112
VOLTS	208 / 230
MOTOR HP	3/4
MOTOR FLA	5.4
PHASE/HERTZ	1/60
TEST STATIC	.40 IN. W.C.
REFRIGERANT	22 DESIGN PSIG 300



LISTED FAN COIL
UNIT 3820



APPROVED ACCESSORIES

KFAEH0201N05	KFAEH1301C05	KFAEH0301N08
KFAEH1401C08	KFAEH0401N10	KFAEH1501C10
KFAEH0601F20	KFAEH1701C20	KFAEH1001F24
KFAEH1101F30	KFAEH0801315	KFAEH0901318
KFAEH2401H20	KFAEH2801C15	KFAEH2501N09
KFAEH2601F15	KFCEH0301H20	KFCEH0501N05
KFCEH0601C05	KFCEH0801N08	KFCEH1001C08
KFCEH1401N09	KFCEH0901N10	KFCEH1101C10
KFCEH1501F15	KFCEH1701C15	KFCEH1601315
KFCEH2001318	KFCEH1801F20	KFCEH1901C20
KFCEH2101F24	KFCEH2201F30	KFAEH2201H10

ELECTRICAL INFORMATION FOR THIS UNIT FOR FIELD INSTALLED ELECTRIC HEATERS, APPLY ELECTRICAL INFORMATION PLATE SUPPLIED WITH HEATER IN THIS BLOCK.

SINGLE SUPPLY CIRCUIT	
L1/L2 HEATER AMPS	0
MAX. OVERCUR. PROTECTION	15
MIN. CAPACITY	6.8

DUAL SUPPLY CIRCUIT	
L1/L2 HEATER AMPS	N/A
MAX. OVERCUR. PROTECTION	N/A
MIN. CAPACITY	N/A
L3/L4 HEATER AMPS	N/A
MAX. OVERCUR. PROTECTION	N/A
MIN. CAPACITY	N/A

HEAT PACK INSTALLED	N/A
---------------------	-----

UNIT HAS INTEGRAL LIMIT CONTROL, MAX. OUTLET TEMP 200F, MOTOR THERMALLY PROTECTED. SEE INSTALLATION INSTRUCTIONS FOR SPECIFIC INSTALLATION REQUIREMENTS AND APPROVED ACCESSORY KIT INFORMATION. MAX. VOLTAGE TO GROUND OF SUPPLY CIRCUIT NOT TO EXCEED 120 VOLTS IF HEATER HAS CIRCUIT BREAKER CONTROL.

COIL FOR COOLING ONLY EXCEPT WHEN INSTALLED AS PART OF A LISTED HEAT PUMP. APPROVED HEATERS MFG'D BY CAL/SEP, INDIANAPOLIS, IN.

CLEARANCE TO COMBUSTIBLE MATERIALS TO BE 8" FOR CHASING, PLENUM AND DUCT FOR UNITS WITH 8 TO 10 KW HEATERS.

FOR UNITS WITH HEATERS 10 KW AND ABOVE, CLEARANCE TO COMBUSTIBLE MATERIAL IS TO BE 8" TO CHASING AND 1" FOR FIRST 24" OF PLENUM AND DUCT.

CAUTION

CAL/SEP
7218 West Morris Street
Indianapolis, IN 46221

PISTON IN THIS COIL MUST MATCH SIZE SHOWN
ON OUTDOOR UNIT RATING PLATE. REPLACE IF
NECESSARY. THIS UNIT IS EQUIPPED WITH PISTON #

96

321816-100 REV. G

Main Floor Heat Pump 265ANA060000BBAA

SERIAL 4308E01230	
PROJ 265ANA060000BBAA	
MODEL 265ANA060-B	
METERING TXU	73 PISTON
DEVICE INDOOR	OUTDOOR
FACTORY CHARGED R410A	
12.38 LBS	5.63 KG
INDOOR TXU SUB COOLING 11 °F	
POWER SUPPLY 208-230 VOLTS AC	
1 PH	60 HZ
PERMISSIBLE VOLTAGE AT UNIT	
253 MAX	197 MIN
SUITABLE FOR OUTDOOR USE	
COMPRESSOR 208/230 VOLTS AC	
1 PH	60 HZ
26.4 LRA	134.0 LRA
FAN MOTOR 208/230 VOLTS AC	
1 PH	60 HZ
1/4" HP	1.3 FLA
DESIGN/TEST PRESSURE GAGE	
HI 450 PSI	3103 KPA
LO 250 PSI	1724 KPA
MAX DESIGN/WORKING PRESSURE	
700 PSIG	4826 KPA
MINIMUM CIRCUIT AMPS 34.3	
MAX FUSE 50 A	MAX CKT-BKR(*) 50 A
* HACR TYPE RECOMMENDED	
MODEL NUMBER 265ANA060000BBAA	
SERIAL NUMBER 4308E01230	
DATE OF MANUFACTURE OCT 2008	
 	
	
ARI Standard 210/240 Unitary Heat Pumps	
CERTIFIED CAPACITY AND EFFICIENCY RATINGS ARE VALID ONLY WHEN THE COMBINATION OF INDOOR UNIT AND OUTDOOR UNIT IS LISTED IN THE ARI DIRECTORY	
Bryant Heating & Cooling Systems 7310 West Morris St. Indianapolis, IN 46231	
332319-4000	